




ARCHITECTURE  
PLANNING  
INTERIOR DESIGN

2425 WEST LOOP SOUTH  
SUITE 665  
HOUSTON TEXAS 77027  
FAX 713-552-9810  
713-552-0707  
WWW.MGARCHITECTS.COM


**PLUMBING PLAN NOTES:**

- ① DO NOT ROUTE PLUMBING PIPING OVER ELECTRICAL PANELS.
- ② 3/4" CONDENSATE DRAIN FROM FAN COIL UNITS TO DROP TO LOW LEVEL INSIDE WALL THEN OUT TO DISCHARGE INTO FRENCH DRAIN WITH AIR GAP PER CODE.
- ⚠ ③ AUXILIARY CONDENSATE DRAIN FROM FAN COIL UNITS TO DROP TO LOW LEVEL INSIDE WALL THEN OUT TO DISCHARGE INTO FRENCH DRAIN WITH AIR GAP PER CODE. CONTRACTOR TO LABEL EACH AUXILIARY DISCHARGE WITH UNIT DESIGNATION.
- ④ STORM PIPING FROM ROOF DRAINS SERVING THE HIGH ROOF AREA TO DROP AND CONNECT TO STORM PIPING FROM ROOF DRAINS SERVING THE LOWER ROOF AREA.
- ⚠ ⑤ 12"X6" EMERGENCY OVERFLOW SCUPPER THROUGH WALL A MAXIMUM OF 2" ABOVE MAIN ROOF DRAIN LEVEL.

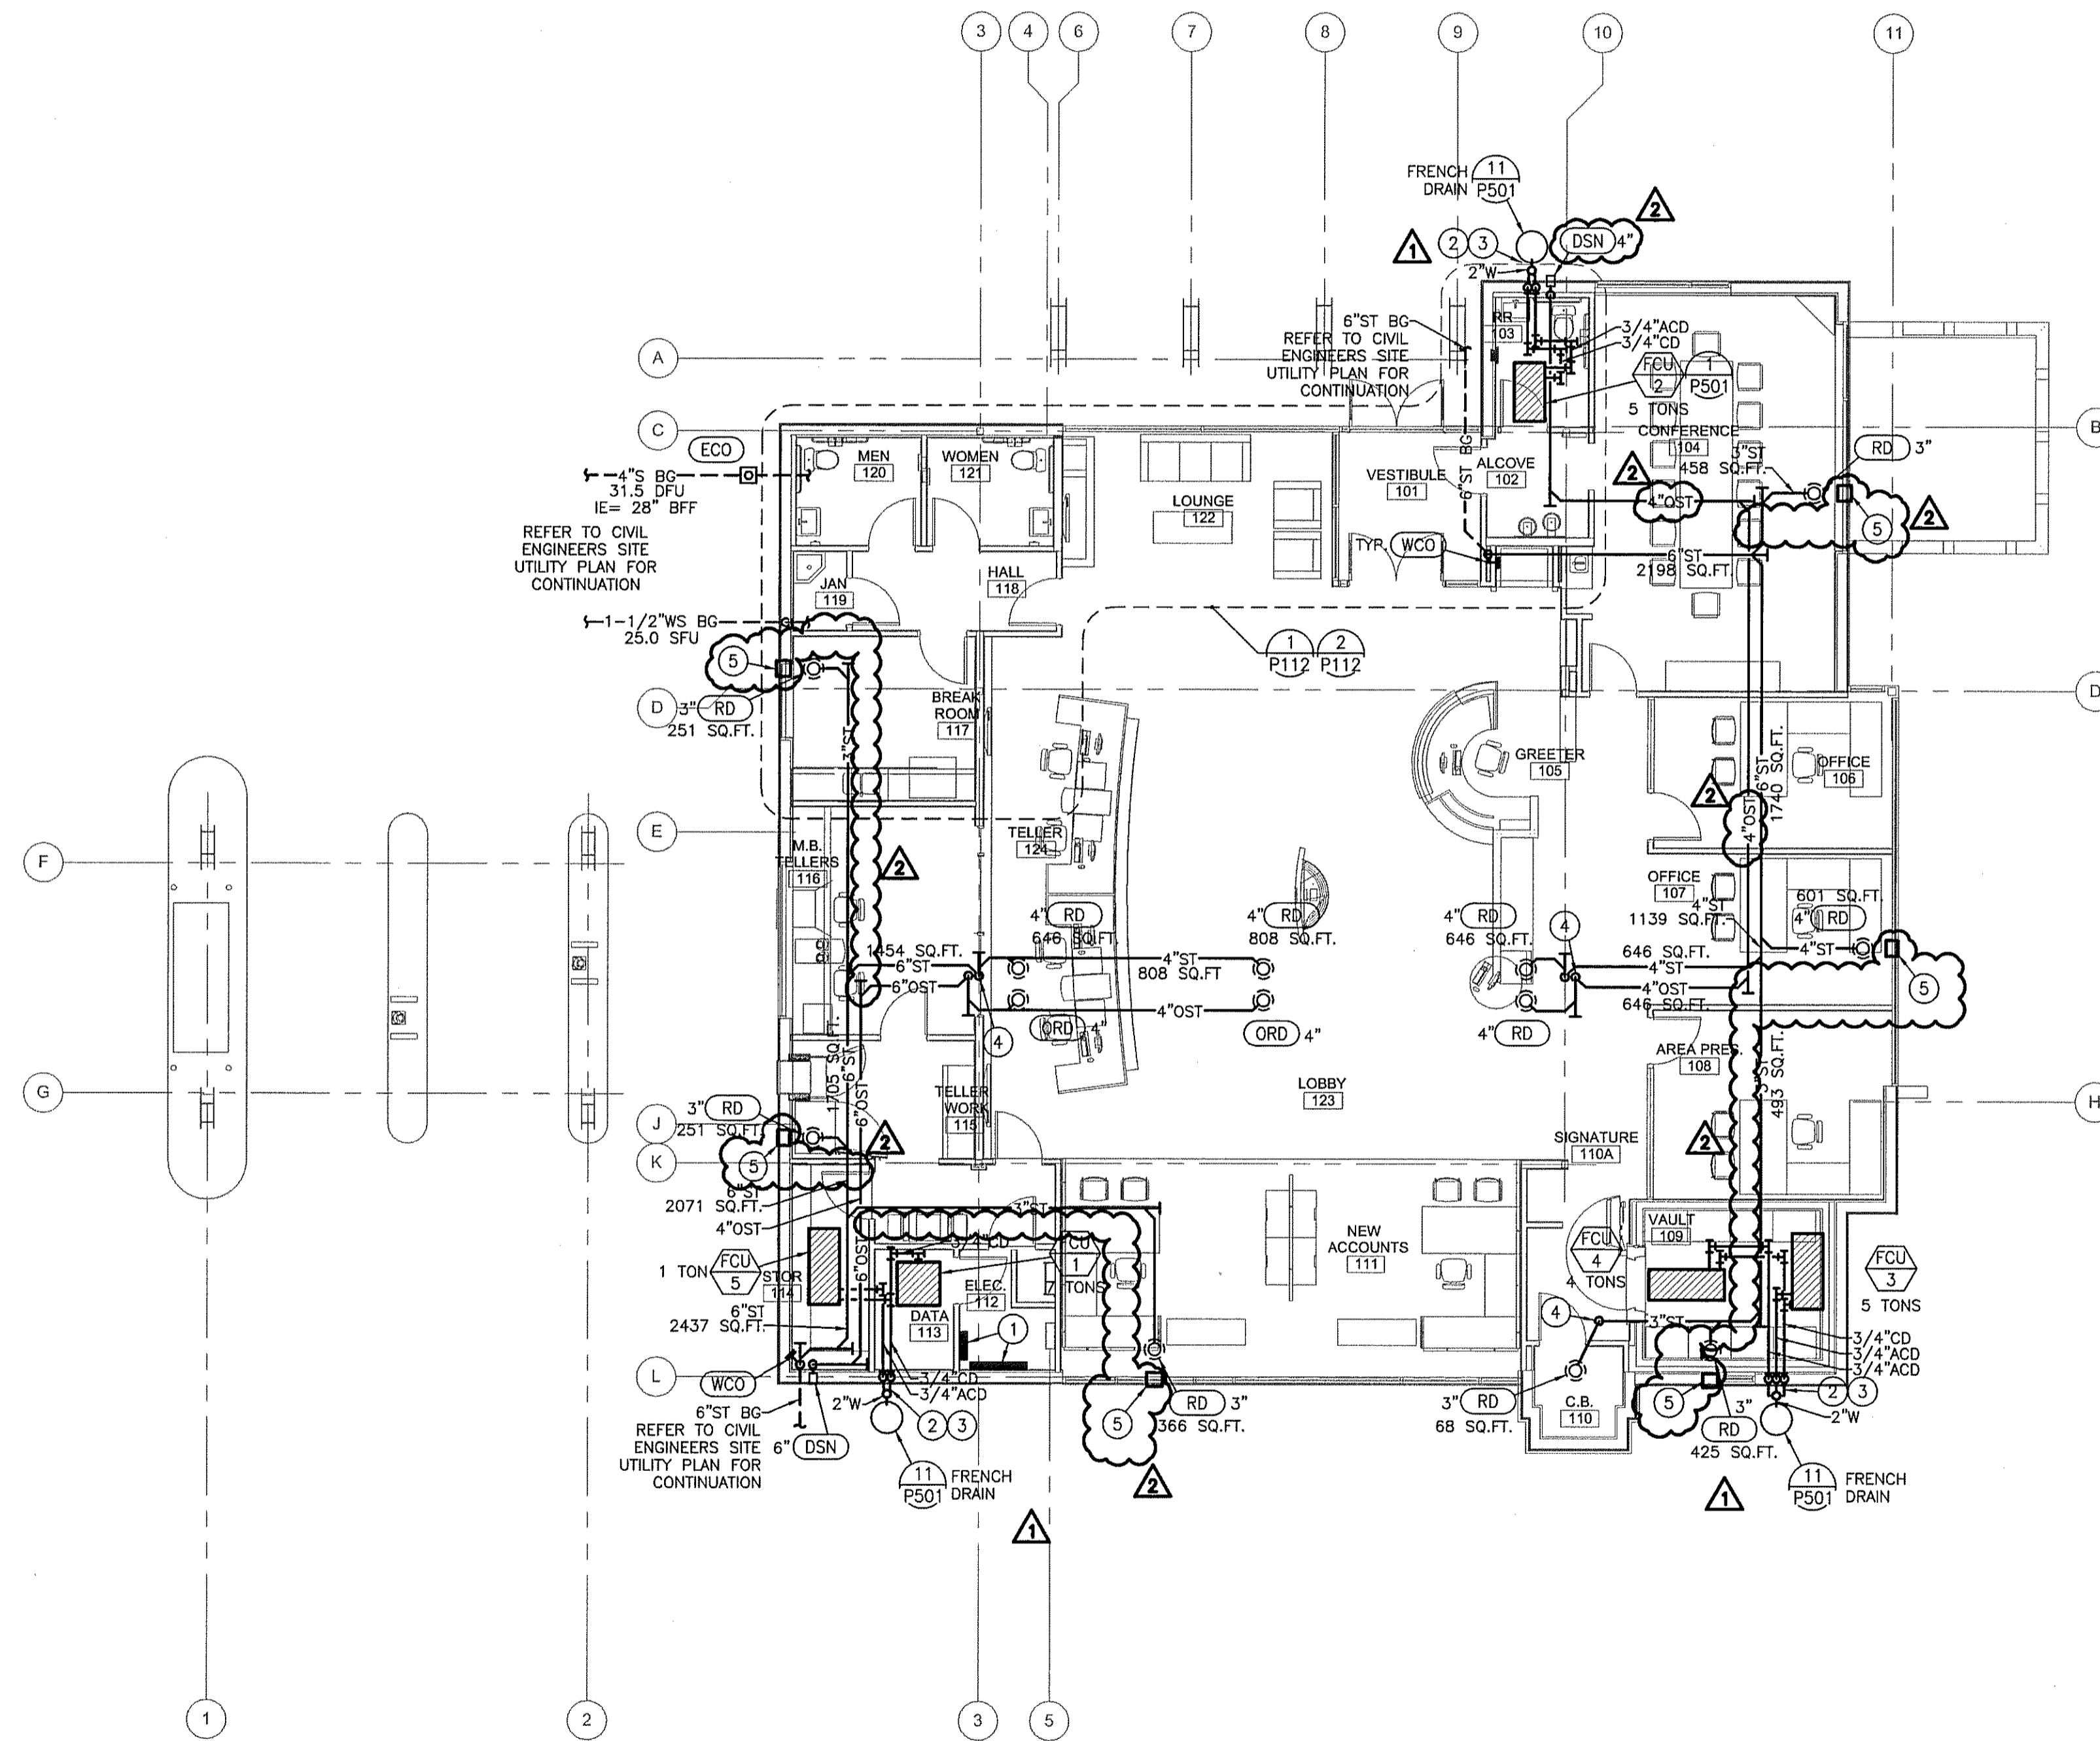

**1 PLUMBING FLOOR PLAN**  
SCALE: 1/8"=1'-0"

PROFESSIONAL ENGINEER  
Phillip G. Miller  
FL PE# -  
51079

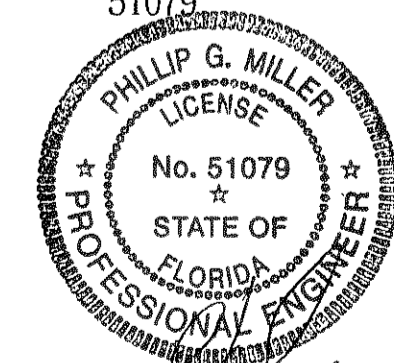

DATE: 3/16/10



10370 RICHMOND AVENUE, SUITE 370  
HOUSTON, TX 77042  
TEL 713 783 7707 FAX 713 783 7797  
www.hel-eng.com  
090000666  
FL CORPORATE NUMBER: EB 7606  
EXPIRES 02/28/11

**CONSULTANTS**

STRUCTURAL ENGINEER:  
SCA Consulting Engineers

M/E/P ENGINEER:  
Henderson Engineers



Aloma Walk Branch  
Aloma Ave.  
Oviedo, FL 32765

**ISSUE:**

MARK	DATE	DESCRIPTION
	09-15-09	DEVELOPER REVIEW
	11-16-09	ISSUE FOR PERMIT
	12-02-09	ISSUE FOR PERMIT
⚠	01-13-10	RESPONSE TO BUILDING PERMIT COMMENTS
	01-29-10	RESPONSE TO BUILDING PERMIT COMMENTS
⚠	03-17-10	BUILDING REVISIONS

PROJECT NO:  
**09-529.a**

**PLUMBING FLOOR PLAN**

**P-111**