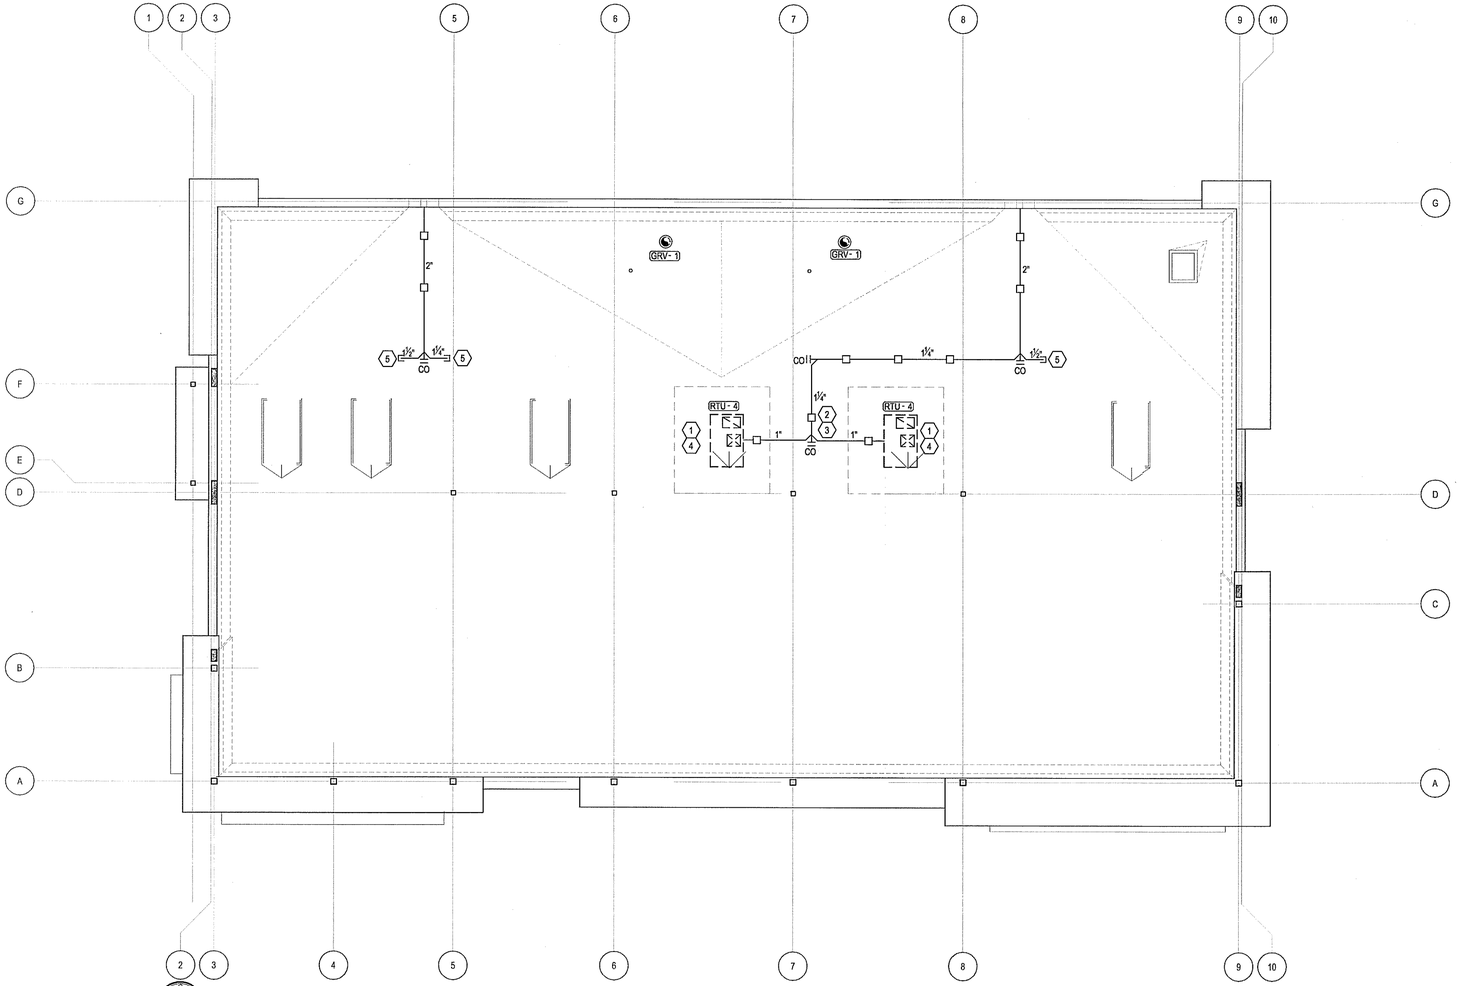

Mechanical Roof Plan
Scale: 1/8"=1'-0"

MECHANICAL KEY PLAN NOTES:

1. COORDINATE EXACT LOCATION OF MECHANICAL UNITS WITH ARCHITECTURAL AND STRUCTURAL DRAWINGS. REFER TO RTU TIE-DOWN DETAIL ON MECHANICAL DETAIL SHEET AND STRUCTURAL DRAWINGS FOR RTU INSTALLATION. COORDINATE WITH MANUFACTURER'S RECOMMENDATIONS.
2. RUN CONDENSATE FROM MECHANICAL UNITS TO ROOF DRAIN/GUTTER AND TERMINATE WITH APPROVED AIR GAP. REFER TO ARCHITECTURAL ROOF PLAN FOR LOCATION OF DRAINS/GUTTER.
3. REFER TO CONDENSATE TRAP DETAIL ON MECHANICAL DETAIL SHEET FOR PIPE SIZE. REFER TO PIPE SUPPORT DETAIL ON MECHANICAL DETAIL SHEET FOR INSTALLATION.
4. INSTALL FLEXIBLE CONNECTIONS BETWEEN ALL DUCT WORK AND MECHANICAL UNITS.
5. RUN CONDENSATE FROM ROOF DRAIN/GUTTER AS INDICATED AND CAP FOR FUTURE CONNECTION.

Cuhaci & Peterson
Architects Engineers Planners
Florida Corporate Certificate #AA C000526
1925 Prospect Avenue, Orlando, FL 32814
Ph. 407.661.9100 - Fax 407.661.9101
www.cpi.com

CLIENT NAME
Weingarten Realty Investors, Inc.
2720 E. Colonial Drive
Orlando, FL 32803

PROJECT NAME
Outparcel 5 @ Palm Coast Landing
N.E.C. SR 100 and Belle Terre Parkway
Palm Coast, Florida

SHEET TITLE
Mechanical Roof Plan

JOSEPH F. KEENE
FL# 60022

PROJECT NO.	RELEASE
230350	
DATE	
08/28/08	
DRAWN	
TAB	
CHECKED	
JFK	

COPYRIGHT © - All reports, plans, specifications, computer files, field data, notes and other documents are instruments of service prepared by Cuhaci & Peterson. (C & P) as instruments of service remain the property of C & P. C & P shall retain all common law, statutory and other reserved rights, including the copyright thereto. Any use or reproduction of this document without written permission from C & P is a violation of federal copyright laws.

M201