FLOW TEST DATA HYDRANT # PH 03228

STATIC:	65 PSI
RESIDUAL:	50 PSI
FLOW:	1140 GPM
PITOT:	46 PSI

BASED ON HYDRAULIC TAG
ON FIRE HYDRANT
HYDRANT @ 3206-3208 COLONIAL DR

ON: AUG. 19TH 2009

* REFER TO CIVIL PLANS FOR ACTUAL PIPE ROUTING

NOTE:

ACTUAL PIPE SIZING, ROUTING AND LOCATION SHALL BE BY THE FIRE SPRINKLER CONTRACTOR PER F.A.C. 61G15. CONTRACTOR SHALL PROVIDE SHOP DRAWINGS AND HYDRAULIC CALCULATIONS TO THE ENGINEER AND FIRE MARSHAL FOR REVIEW.

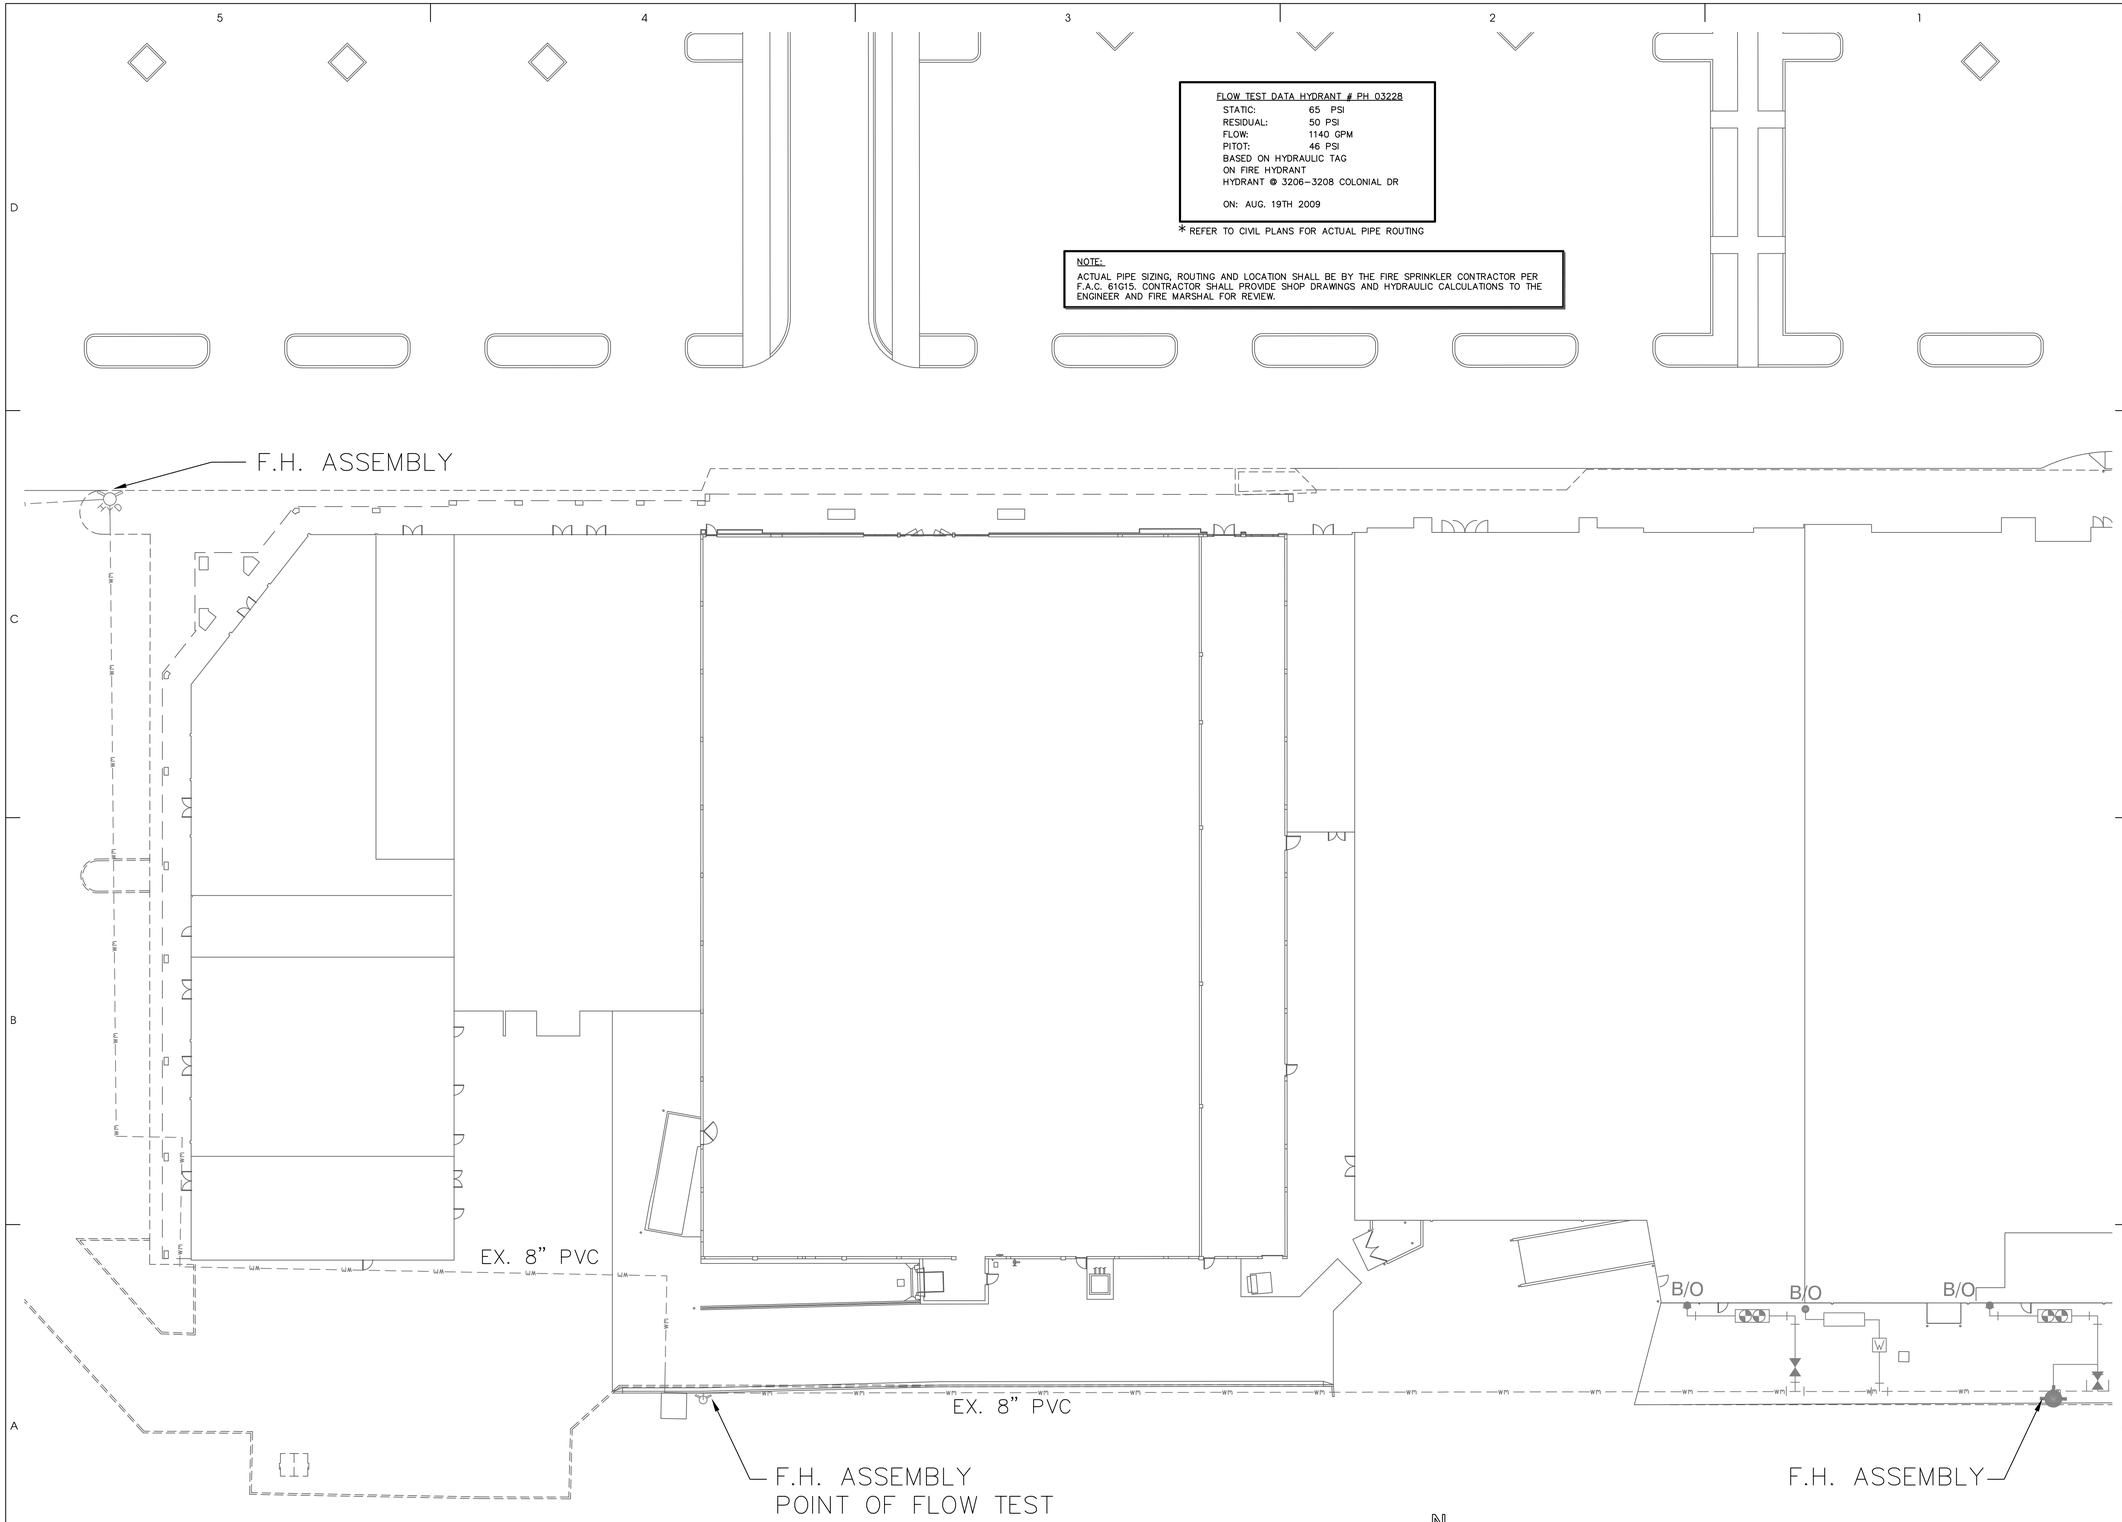

1 / F-0.1 SITE PLAN - FIRE PROTECTION
SCALE: 1" = 30'-0"

N

rojo

rojo Architecture
AA 0002952
5701 E. Hillsborough Avenue
Suite 1130
Tampa, FL 33610

813 630 5508 (p)
813 630 5518 (f)

(e-mail) rojo@rojoarchitecture.com
www.rojoarchitecture.com

STATE OF FLORIDA
REGISTERED ENGINEER

MARK E. AWMILLER, P.E.
53973

MES
MECHANICAL ENGINEERING SOLUTIONS, INC.
5421 Beaumont Center Blvd., Suite 675, Tampa, Fl 33634
Ph. 813.885-9600 Fax 813.884-0045
Certificate #8304 Project # 2010511
Mark E. Awmiller, P.E. 53973

PartyCity
THE DISCOUNT PARTY SUPER STORE

COLONIAL LANDING
SHOPPING CENTER
3220 EAST COLONIAL BLVD.
ORLANDO, FL

Mark	Date	Description
-	3/2/10	Permit Set

Issue/Revision	Permit Set
Project ID	10003
CAD File Name	10003-CD.vwx
Drawn By	DM
Checked By	MEA
Plot Date:	3/2/10
Record Date:	Record Date

Sheet Title

SITE PLAN -
FIRE PROTECTION

SCALE: 1"=30'-0"

Drawing No.

F-0.1